

XHEZ.C-AJ-8045 - Through-penetration Firestop Systems

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

XHEZ - Through-penetration Firestop Systems

XHEZ7 - Through-penetration Firestop Systems Certified for Canada


[See General Information for Through-penetration Firestop Systems](#)

[See General Information for Through-penetration Firestop Systems Certified for Canada](#)

System No. C-AJ-8045

February 29, 2016

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings — 2 and 3 Hr (See Item 3)	F Ratings — 2 and 3 Hr (See Item 3)
T Rating — 0 Hr	FT Rating — 0 Hr
L Rating At Ambient — Less Than 1 CFM/sq ft	FH Ratings — 2 and 3 Hr (See Item 3)
L Rating At 400 F — Less Than 1 CFM/sq ft	FTH Rating — 0 Hr
	L Rating At Ambient — Less Than 5.1 L/s/m ²
	L Rating At 400 F — Less Than 5.1 L/s/m ²

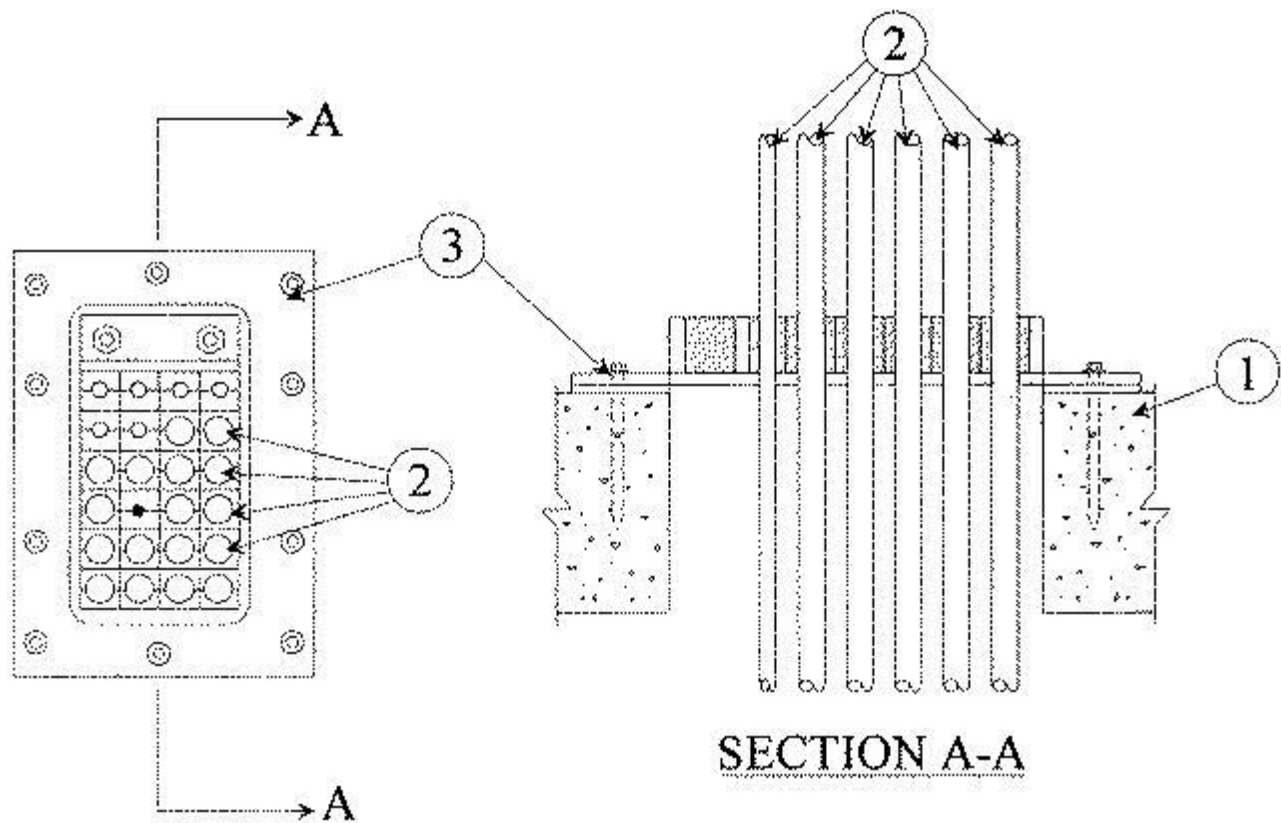

1. **Floor or Wall Assembly** — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max area of opening is 40 sq in. with max dimension of 8-1/2 in. (216 mm).

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Through Penetrants** — Various types of cables, pipe, conduit or tubing may be used as described below. Cables, pipe, conduit or tubing to be rigidly supported on each side of floor or wall assembly.

A. Max 3/C with Ground — No. 8 AWG (or smaller) cable with cross-linked polyethylene insulation and PVC jacket.

B. Max 3/C with Ground — No. 6 AWG (or smaller) cable with cross-linked polyethylene insulation and PVC jacket.

C. Nom 1/2 in. (13 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.

D. Nom 1/2 in. (13 mm) diam (or smaller) electrical metallic tubing or steel conduit.

3. **Firestop Device*** — Firestop device consists of a rectangular steel frame, insert modules, stay plates and compression unit consisting of top-packing and compression plate or ROX Wedge. The firestop device shall be installed on top surface of the floor and on both surfaces of the wall assembly in accordance with the accompanying installation instructions. The steel frame of the firestop device shall be secured to the top surface of the floor and on both surfaces of the wall assembly by means of 3/8 in. (10 mm) diam by 2-1/4 in. (57 mm) long steel expansion anchors and steel washers spaced a max 3-1/2 in. (89 mm) OC. Two continuous min 1/4 in. (6 mm) diam beads of silicone RTV sealant shall be applied as a gasket between the device frame mounting flange and the floor or wall surface. As an alternate to the RTV sealant, a nom 5/16 in. (8 mm) thick by 5/16 in. (8 mm) wide butyl rubber gasket with self-adhesive may be installed around the mounting flange. The sealant beads or gasket shall be recessed in approx 1/2 in. (13 mm) and 2 in. (51 mm) from the perimeter of the device frame mounting flange such that the continuous beads bracket the line of fasteners along each side of the device.

The annular space between the through penetrants and the periphery of the steel frame shall be filled with insert modules. The sheets of the module halves are removed one by one until a gap of 0 to 1 mm is formed between the two module halves. During the installation of the insert modules, thin metal stay plates shall be used to separate each row of insert modules and retain the insert modules within the steel frame. After installation of the modules, the bolts of the compression unit are tightened to form an effective seal around the through penetrants and insert modules. The firestop device may consist of one or more size frames ganged or grouped together in accordance with the accompanying installation instructions. The hourly F Ratings for the firestop devices are dependent upon the type of compression

unit used and the use of a gasket. In order to achieve a 3 h F Rating, the compression unit shall consist of the ROX Wedge. Any other compression unit will result in a 2 h F Rating. Within each firestop device, any combination of the penetrating items can be used up to its max percent fill or max number as described below:

Penetrating Item	Max % Fill of Cable (a)	Max No. of Pipe Conduit or Tube
A	4.6	—
B	14.6	—
C	—	1

(a)

Percent fill of cables is based upon total cross sectional area of cable divided by the area within the steel frame.

NMP CORP — ROX SF-2, ROX SF-4 or ROX SF-6

ROXTEC INTERNATIONAL AB — ROX SF-2, ROX SF-4 or ROX SF-6

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2016-02-29

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2021 UL LLC"